



Case Study

3.45MW-6.88MWh


5MWp

BESS 5MWp


3.45MW-6.88MWh

2 SunTera 3.44MWh



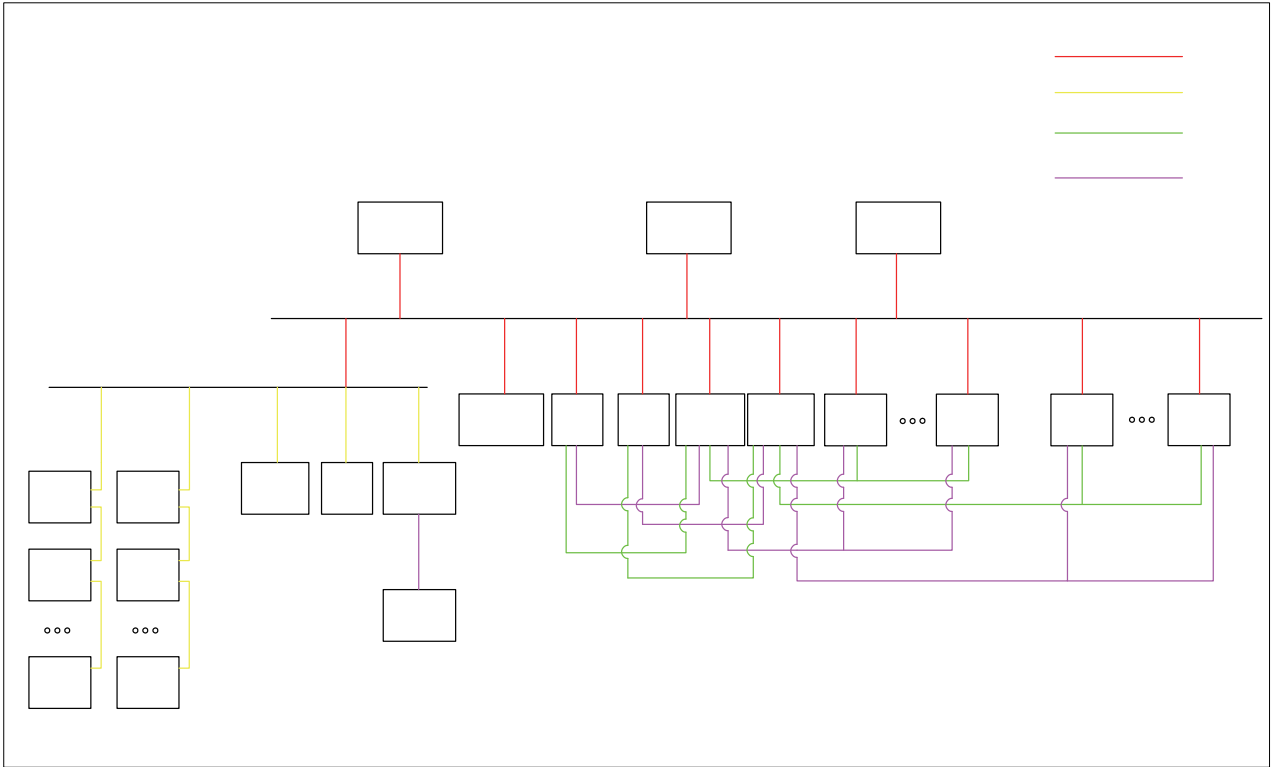

2.

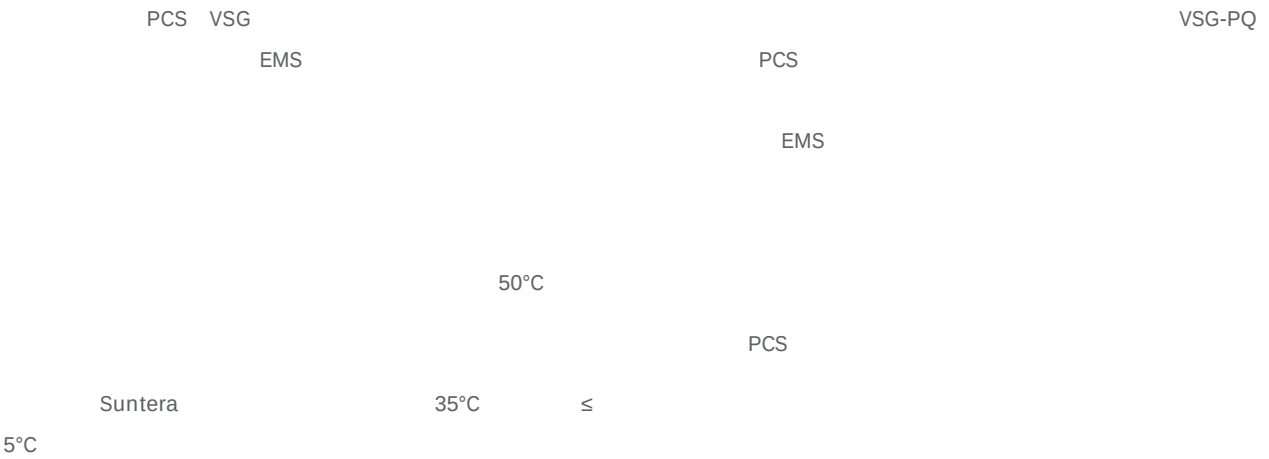




SOC 93%

707.37kW

PCS

3

789.3kW

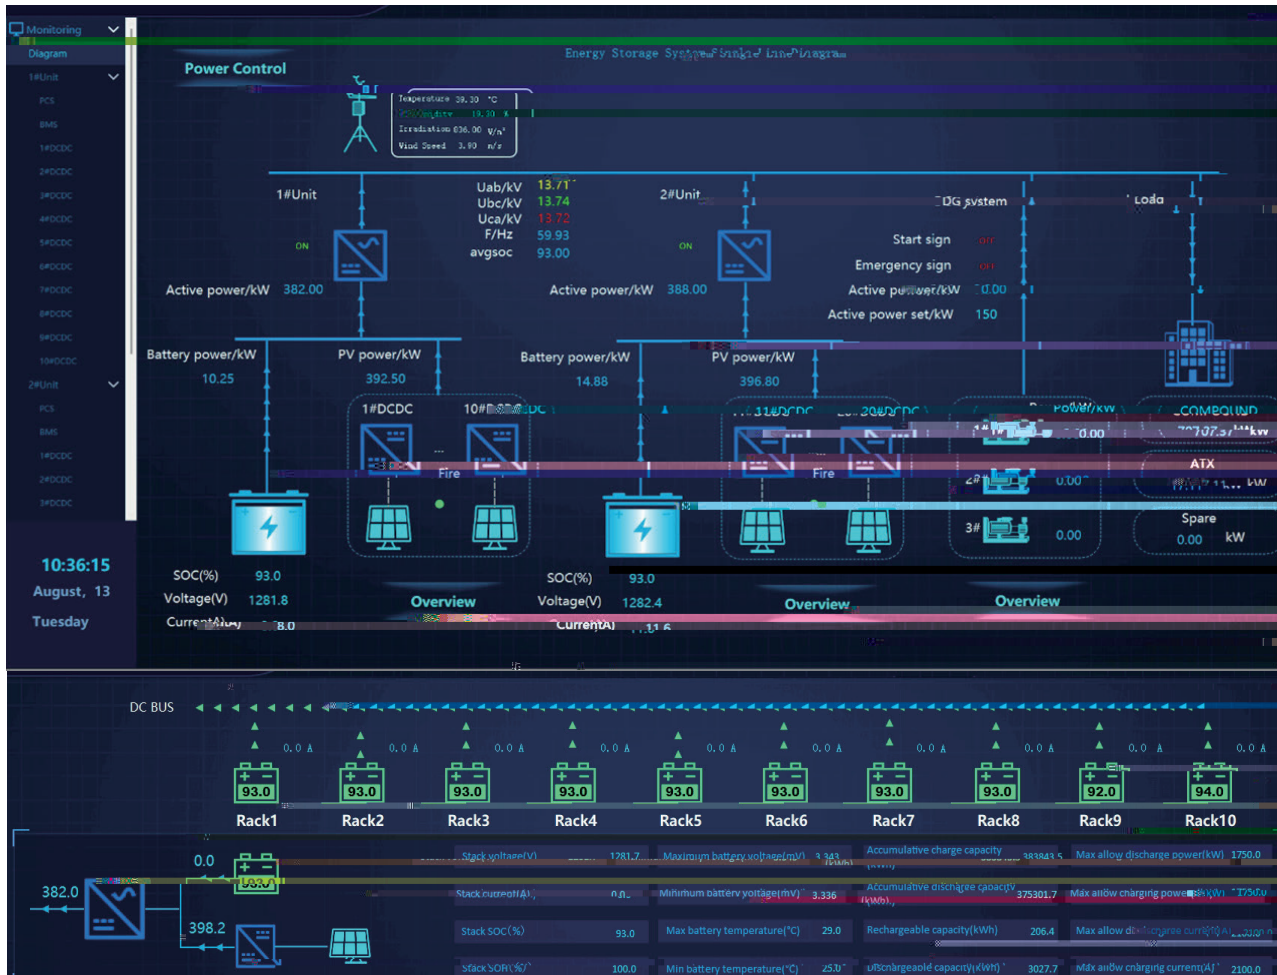

5,6. EMS



7,8. EMS


MW SunTera 1500V DC-DC

26

PCS VSG 50
2 1725kVA PCS SunTera
SOC

35

5

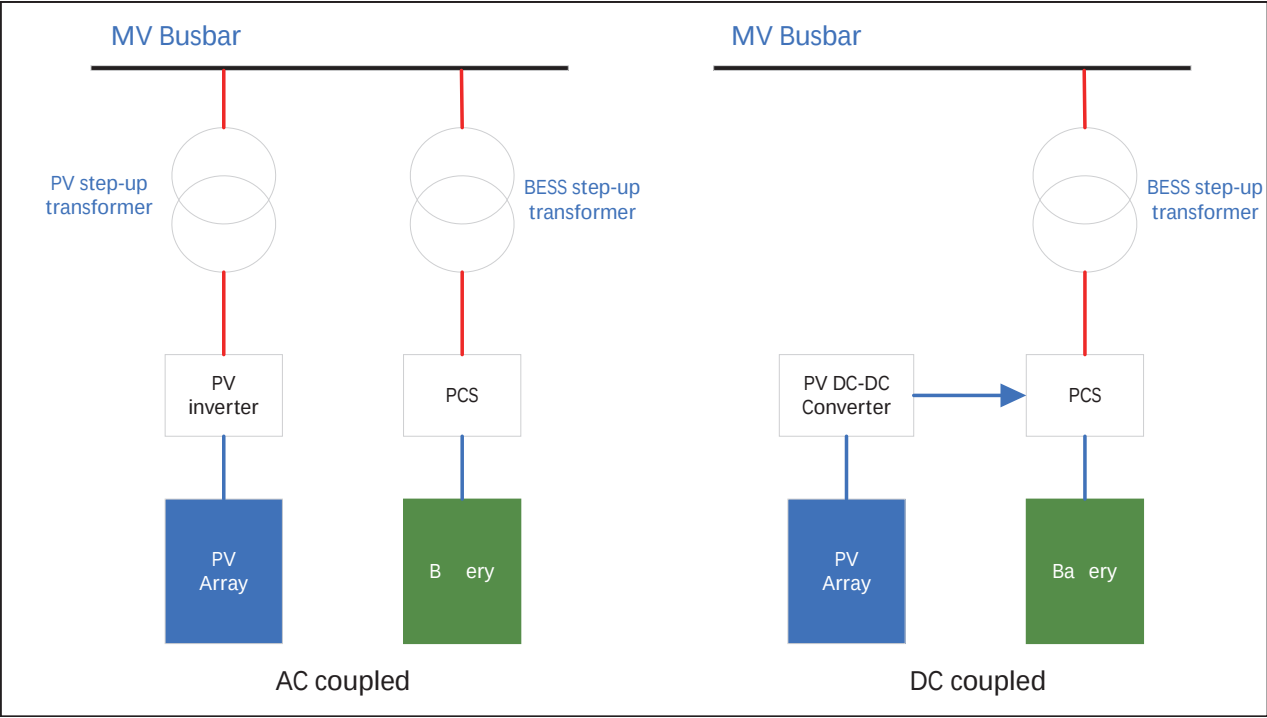

9. 9. VS



10.

*



1466 1
+86 400 860 8878

Case Study

3.45MW-6.88MWh

5MWp